


**UTILITY NOTE:**  
CONTRACTOR SHALL LOCATE ALL UNDERGROUND UTILITIES AND EXERCISE EXTREME CAUTION WHILE EXCAVATING, TRENCHING, OR INSTALLING NEW STORM DRAIN PIPES. ANY DAMAGE TO ANY UNDERGROUND UTILITY SHALL BE IMMEDIATELY REPAIRED AT THE CONTRACTOR'S EXPENSE.

**FENCE NOTE:**  
EXISTING FENCE REQUIRED TO BE REMOVED AND REPLACED TO INSTALL NEW STORM DRAIN PIPES SHALL BE CONSIDERED INCIDENTAL TO APPROPRIATE D-701 PAY ITEM FOR THE STORM DRAIN PIPE. NO SEPARATE PAYMENT WILL BE MADE FOR REMOVAL AND REPLACEMENT OF EXISTING FENCE.

**STORM DRAINAGE NOTES:**

1. ALL CONCRETE PIPE (RCP) SHALL BE CLASS III REINFORCED CONCRETE PIPE CONFORMING TO ASTM C76 HAVING TONGUE AND GROOVE JOINTS.
2. ALL PIPE JOINTS AND JOINT MATERIAL ARE TO PROVIDE A WATERTIGHT CONNECTION.
3. ALL PIPE TO BE INSTALLED ACCORDING TO MANUFACTURER'S RECOMMENDATIONS AND REQUIREMENTS TO THE LINES AND GRADES AS SHOWN ON THE PLANS. BACKFILL TRENCHES IN 4" LIFTS AND COMPACT EACH LIFT IN ACCORDANCE WITH THE EMBANKMENT COMPACTION REQUIREMENTS. ALL BACKFILL IS TO BE IN ACCORDANCE WITH PROJECT SPECIFICATIONS AND GEOTECHNICAL REPORT.
4. AFTER COMPLETION OF EACH SECTION OF PIPE, PROTECT FROM SEDIMENT AND DEBRIS ACCUMULATION INSIDE OF THE PIPE. CLEAN AND FLUSH ALL SEDIMENT FROM THE PIPE AND DISCHARGE IN ACCORDANCE WITH THE REQUIREMENTS FOR EROSION AND SEDIMENT CONTROL. AFTER INSTALLATION AND DURING THE REMAINDER OF THE CONSTRUCTION PERIOD, PROVIDE INLET PROTECTION FOR STORM WATER PIPES AND INLET STRUCTURES WITH SILT FENCE, OR OTHER ACCEPTED MEANS TO PREVENT SILT ACCUMULATION IN THE STORMWATER SYSTEM.
5. PROPOSED INLETS SHALL BE CITY OF MEMPHIS STANDARD INLETS & GRATES. SEE SHEETS C-DT-02 THROUGH C-DT-03 FOR DETAILS.

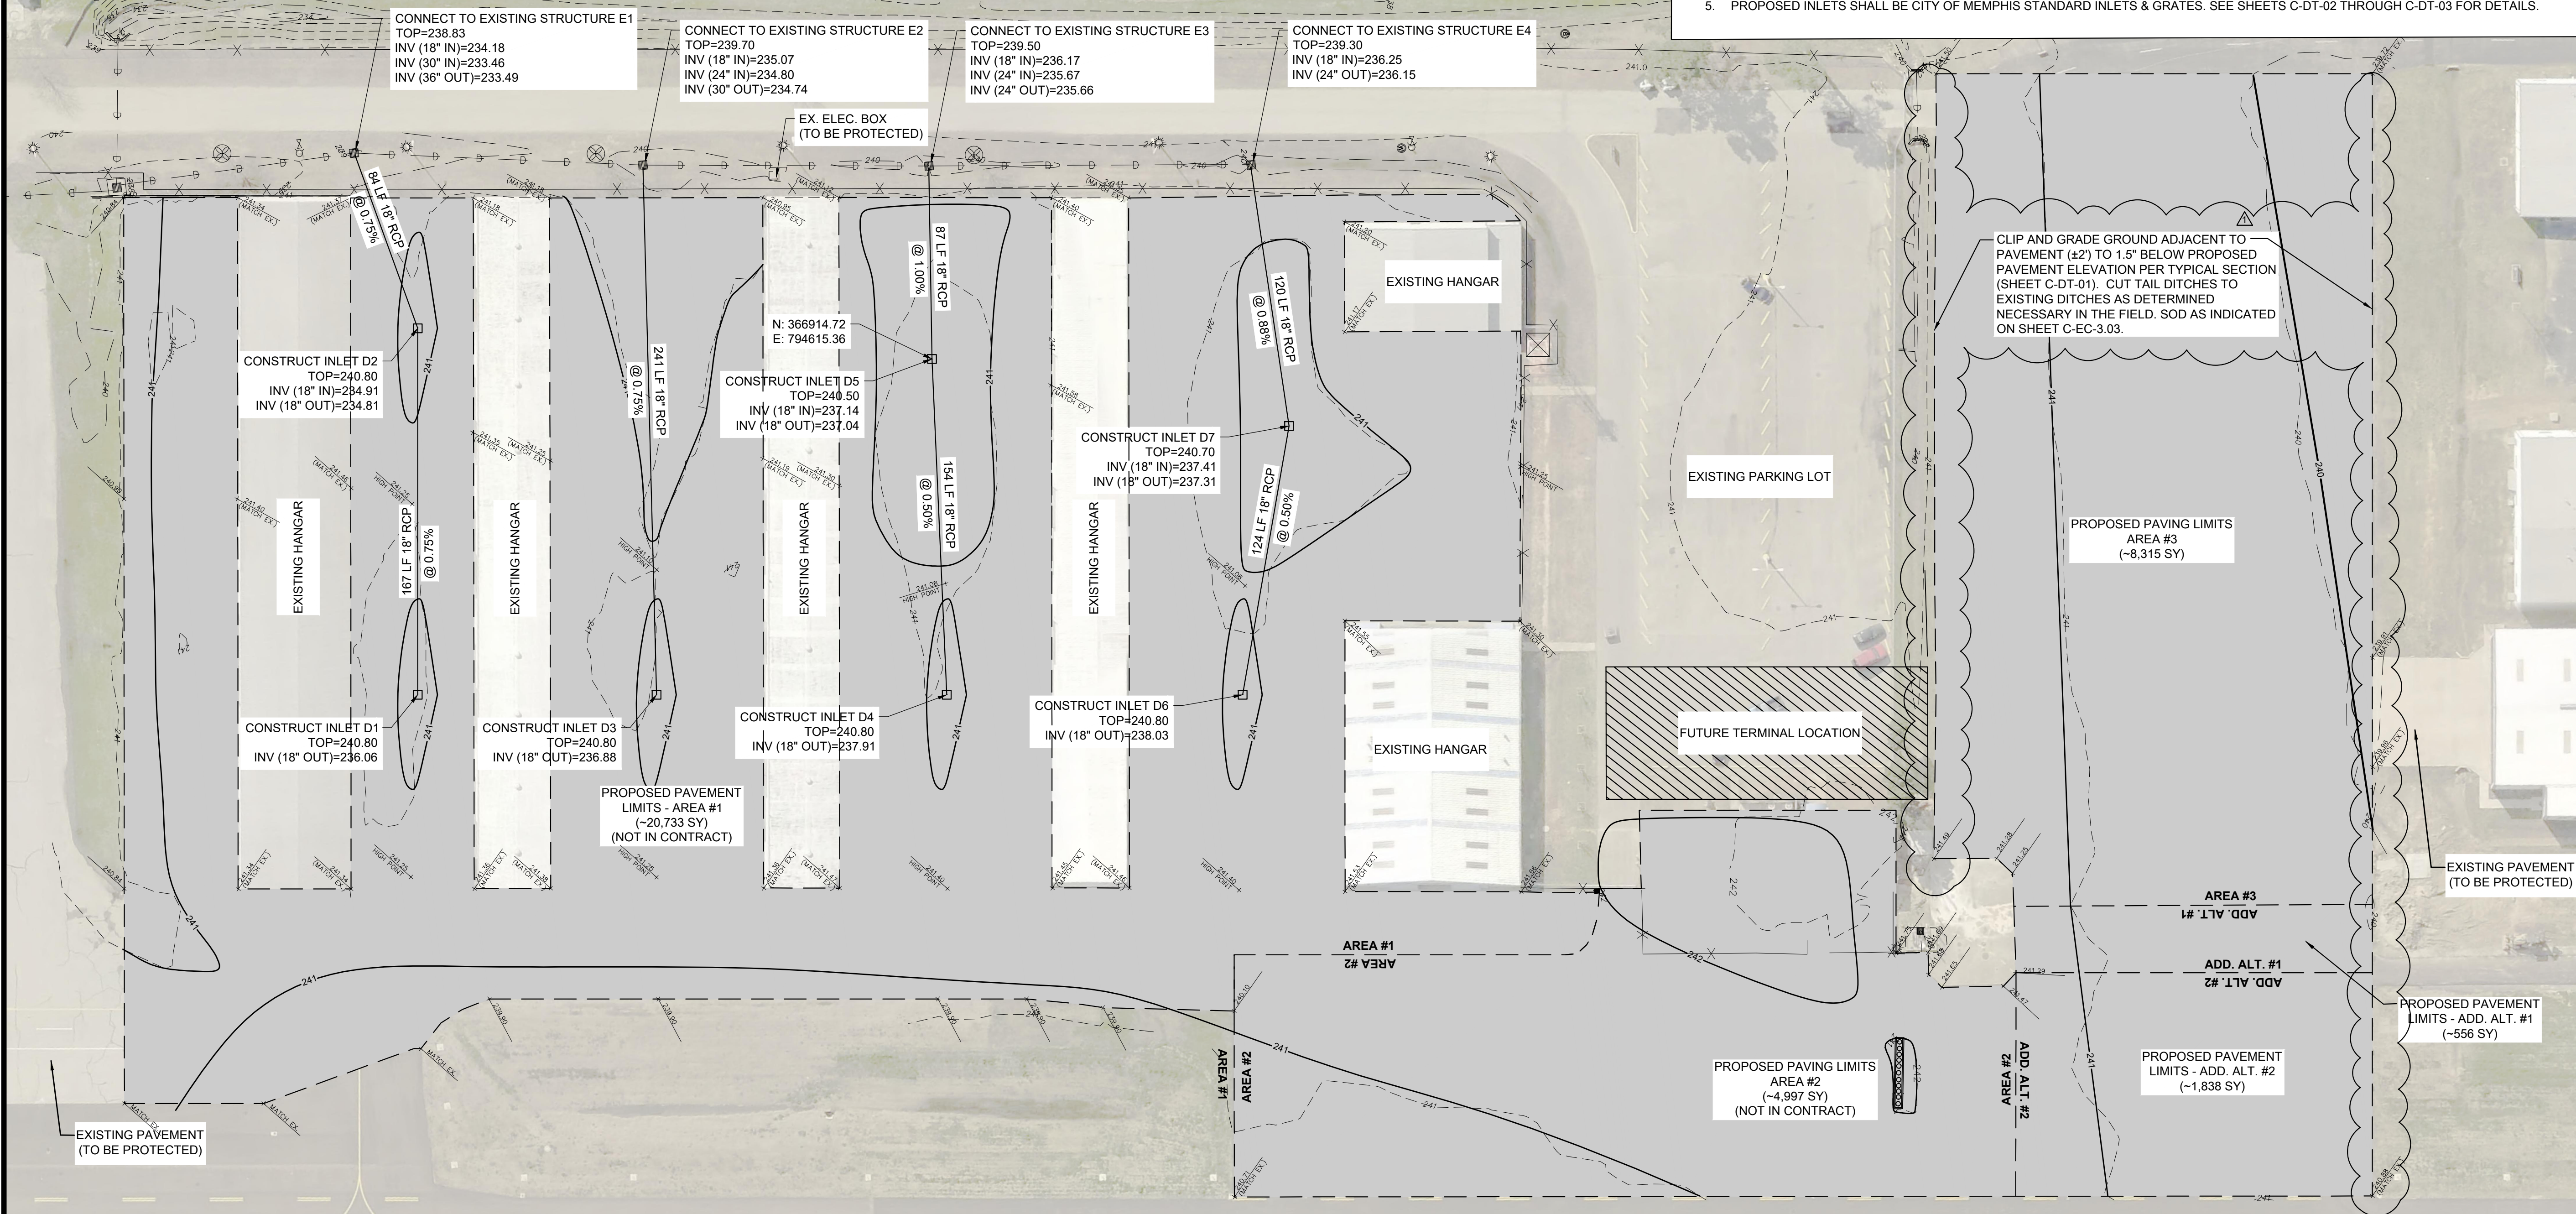

**GRADING NOTES:**



1. ALL PROPOSED CONTOURS REPRESENT PROPOSED FINISHED SURFACE GRADE.
2. PROPOSED TYPICAL SECTIONS SHALL PROVIDE A SMOOTH TRANSITION BETWEEN EXISTING AND PROPOSED SURFACES. MATCH EXISTING ELEVATION WHEN TYING INTO ADJACENT PAVEMENTS. FOR AREAS NOT ADJACENT TO EXISTING PAVEMENT, PROVIDE 1.5" DROP FROM TOP OF PAVEMENT TO SOD. REFERENCE TYPICAL SECTIONS SHOWN ON C-DT-01 FOR MORE DETAILS.
3. AT ALL TIMES MAINTAIN THE AREA SO IT WILL BE WELL DRAINED IN ACCORDANCE WITH THE EROSION AND SEDIMENT CONTROL REQUIREMENTS. THE EROSION CONTROL DEVICES SHALL BE THE FIRST ITEM OF CONSTRUCTION AND REMAIN FUNCTIONAL. THEY WILL REQUIRE PERIODIC MAINTENANCE AS PART OF THE CONTRACT. REFER TO SHEETS C-EC-01.01 THRU C-EC-07.01 FOR DETAILS. ALL PROPOSED GRADING SHALL BE CONSIDERED UNCLASSIFIED. IT IS UNDERSTOOD THAT ANY REFERENCE TO ROCK, EARTH, OR OTHER MATERIALS ON THE DRAWINGS IS NOT AN INDICATION OF CLASSIFIED EXCAVATION.
4. STRIP AND STOCKPILE ALL TOPSOIL IN CUT AND FILL AREAS. PROVIDE ADEQUATE EROSION AND SEDIMENT CONTROL FOR ALL STOCKPILES. TAKE CARE TO AVOID MIXING SUBSOIL AND OTHER UNSUITABLE MATERIAL WITH THE TOPSOIL.
5. DISTURB ONLY THOSE AREAS NECESSARY FOR THE CURRENT PHASE OF WORK. THE CONTRACTOR IS RESPONSIBLE FOR AND SHALL PROTECT ANY AND ALL EXISTING UTILITIES, STRUCTURES, PIPES, CULVERTS, CONDUITS, WIRES, OR OTHER ITEMS TO REMAIN. THE CONTRACTOR SHALL, AT THEIR OWN EXPENSE, REPAIR OR REPLACE ANY DAMAGE THAT MAY RESULT FROM THEIR OPERATIONS.
6. AFTER COMPLETION OF STRIPPING IN FILL AREAS AND ONCE GRADE IS ACHIEVED IN CUT AREAS, PROOFROLL AS DIRECTED BY THE GEOTECHNICAL ENGINEER. UNDERCUT AND BACKFILL ANY UNSUITABLE MATERIALS AS DIRECTED BY THE GEOTECHNICAL ENGINEER.
7. FILL MATERIAL SHALL CONTAIN NO ROCK FRAGMENTS LARGER THAN FOUR INCHES IN ANY DIMENSION AND NO ORGANIC MATTER.
8. COMPACTION IN UTILITY TRENCHES SHALL BE PERFORMED IN MAXIMUM OF FOUR INCH LIFTS.

STRUCTURE TABLE					
ID	TYPE	NORTHING	EASTING	TOP	DA (AC.)
D1	NO. 10 INLET	366663.54	794740.11	240.80	0.40
D2	NO. 10 INLET	366683.15	794573.90	240.80	0.32
D3	NO. 10 INLET	366771.85	794752.89	240.80	0.43
D4	NO. 10 INLET	366903.44	794768.42	240.80	0.41
D5	NO. 10 INLET	366914.72	794615.36	240.50	0.54
D6	NO. 10 INLET	367037.62	794784.25	240.80	0.48
D7	NO. 10 INLET	367073.10	794664.88	240.70	0.83
E1	EX. INLET	-	-	238.83	-
E2	EX. INLET	-	-	239.70	-
E3	EX. INLET	-	-	239.50	-
E4	EX. INLET	-	-	239.30	-

PIPE TABLE									
FROM	INVERT	TO	INVERT	SIZE (INCHES)	LENGTH (LF)	SLOPE (%)	Q <sub>c</sub> (CFS)	Q <sub>a</sub> (CFS)	
D1	236.06	D2	234.91	18	167	0.75	9.10	2.88	
D2	234.81	E1	234.18	18	84	0.75	9.10	5.18	
D3	236.88	E2	235.07	18	241	0.75	9.10	3.09	
D4	237.91	D5	237.14	18	154	0.50	7.43	2.95	
D5	237.04	E3	236.17	18	87	1.00	10.50	6.83	
D6	238.03	D7	237.41	18	124	0.50	7.43	3.45	
D7	237.31	E4	236.41	18	120	0.88	9.85	9.42	

**LEGEND**

- 240 --- EXISTING MAJOR CONTOUR
- 239 --- EXISTING MINOR CONTOUR
- 240 --- PROPOSED MAJOR CONTOUR
- 241 --- PROPOSED MINOR CONTOUR

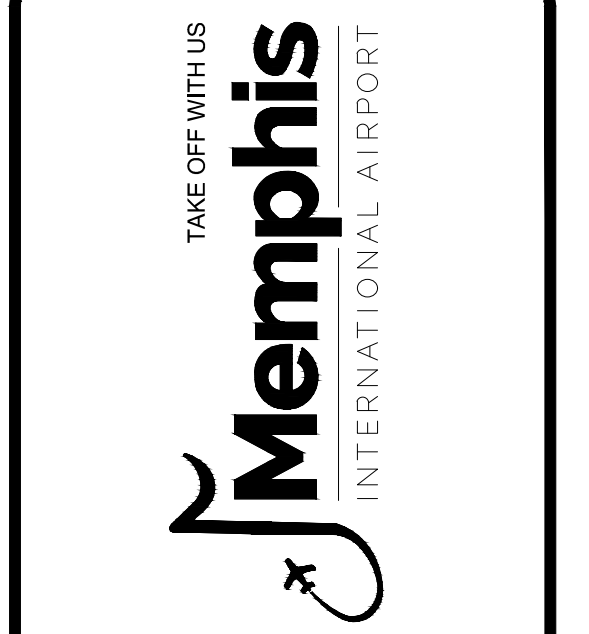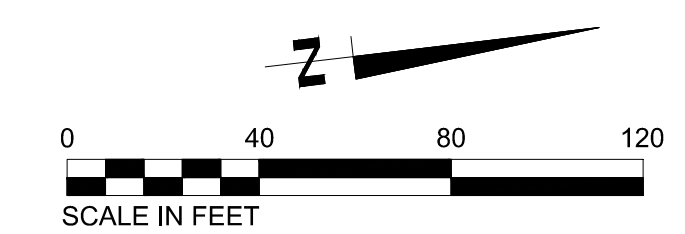

PROGRAM MANAGER  
**BARGE**  
DESIGN SOLUTIONS, INC.  
65 GERMANTOWN CT, SUITE 100  
MEMPHIS, TN 38018

ENGINEER  
**BARGE**  
DESIGN SOLUTIONS, INC.  
65 GERMANTOWN CT, SUITE 100  
MEMPHIS, TN 38018

JOB NO. 33276-02

DRAWN BY: JEM  
CHECKED BY: JDG  
APPROVED BY: JEG

REGISTERED ENGINEER  
JAMES E. MALONE  
No. 111671  
STATE OF TENNESSEE  
03/18/2024

This information is released solely for its use in the interest of the Memphis-Shelby County Airport Authority (MSCAA) or its Tenants. All drawings received from MSCAA or produced for MSCAA as a work product shall be regarded as privileged information, not to be released to others without the express written permission of MSCAA. Your acceptance of the released materials establishes your understanding of, and commitment to, providing adequate control of the materials issued and produced.

REVISIONS		
MARK	DATE	DESCRIPTION
	3/11/24	ISSUED FOR BID
▲	4/18/24	ADDENDUM #2

MSCAA PROJ. NO. 18-1420-01

PROJECT: CHARLES BAKER PAVEMENT RECONSTRUCTION

SHEET TITLE: SITE GRADING PLAN (AREAS 1, 2 & 3)

DWG. FILE NAME: 3327602-61C-GR-01.DWG  
DATE: 03/11/2024  
SCALE: 1"=40'

SHEET NO. C-GR-01  
SHEET 19 OF 47